

1

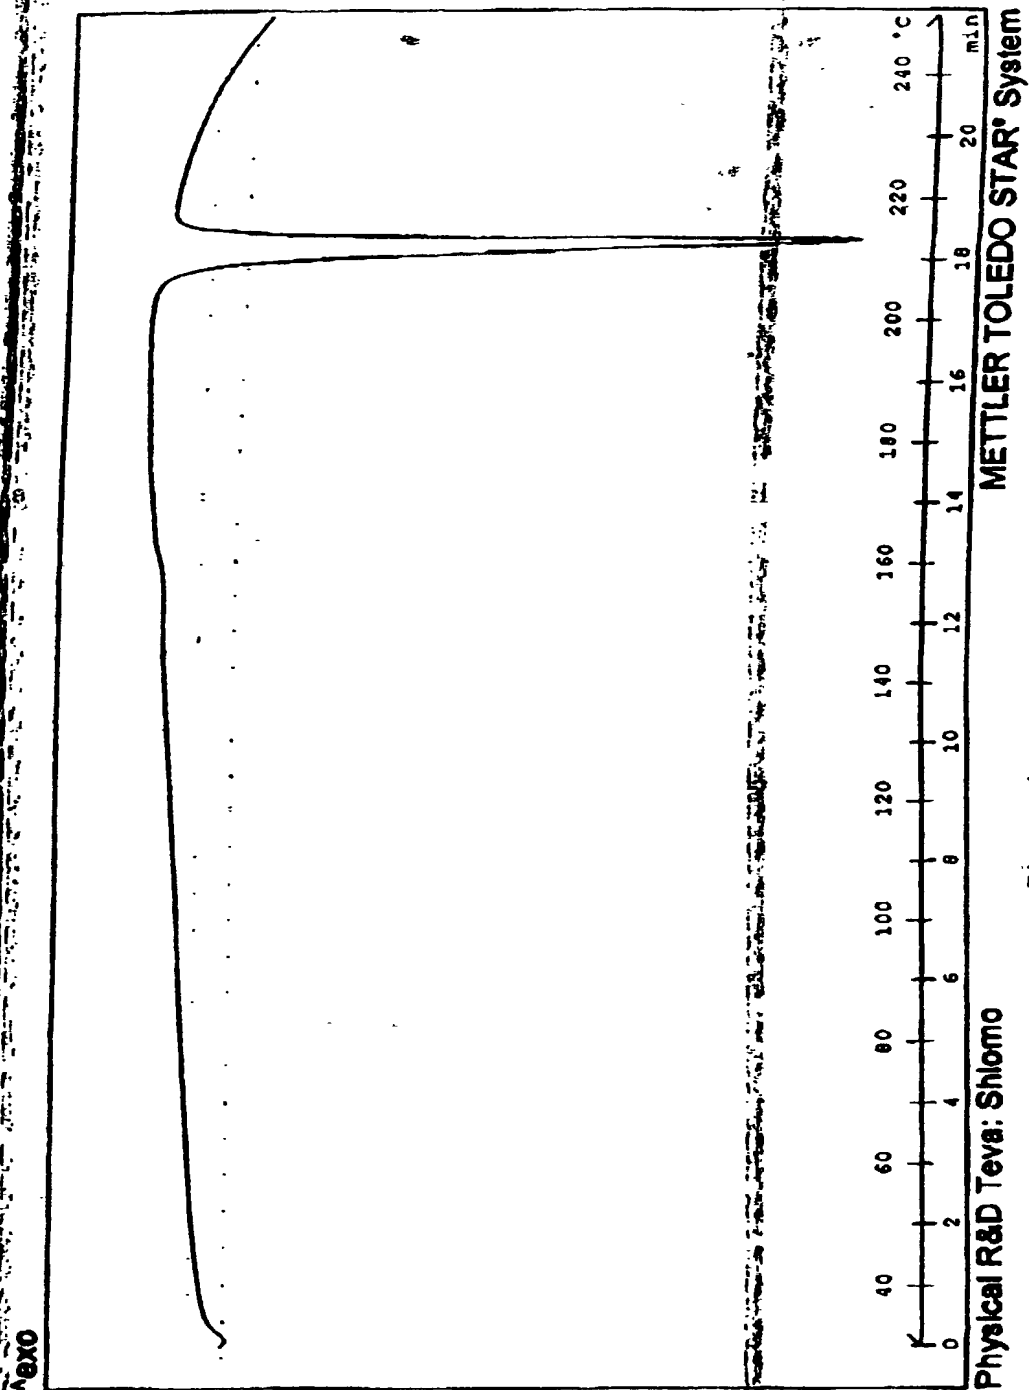


Figure 1




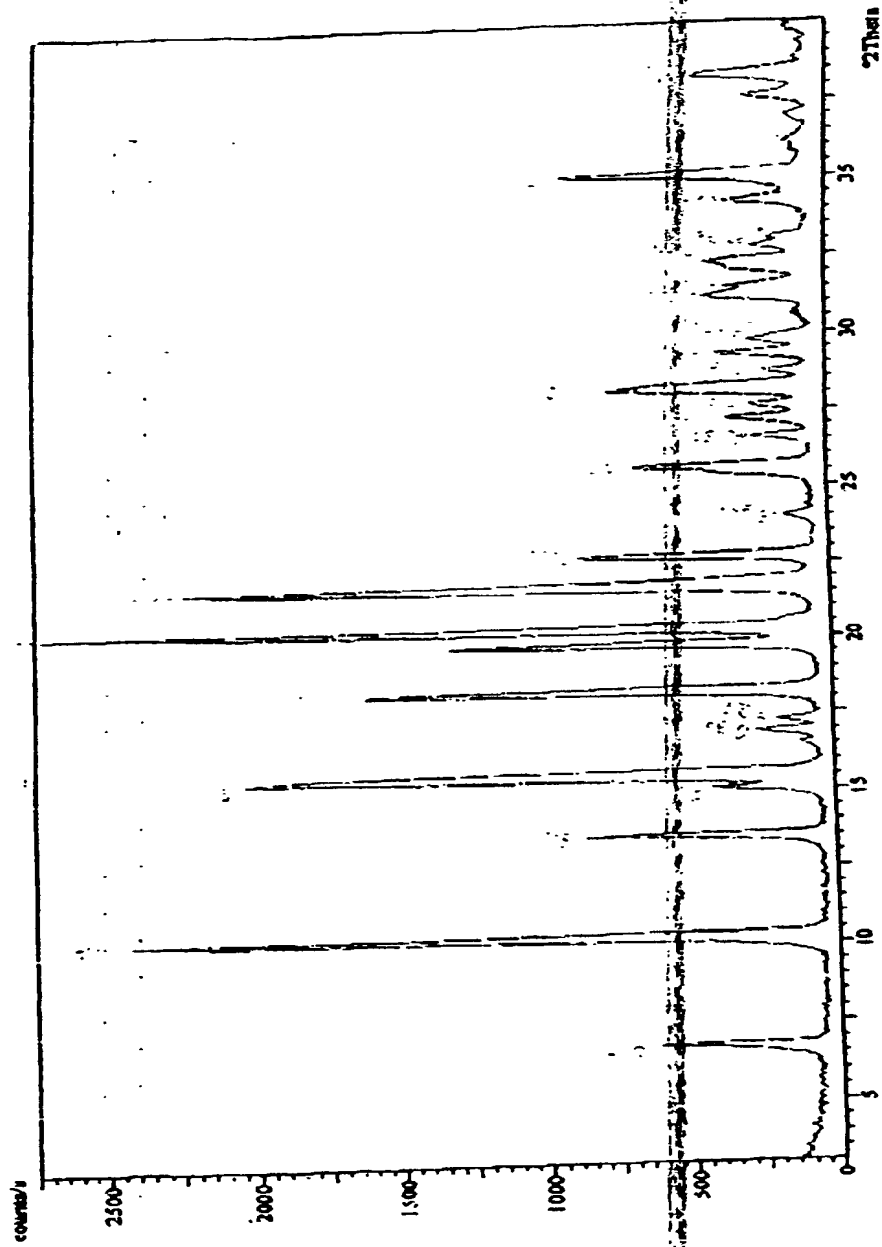


Figure 2



II

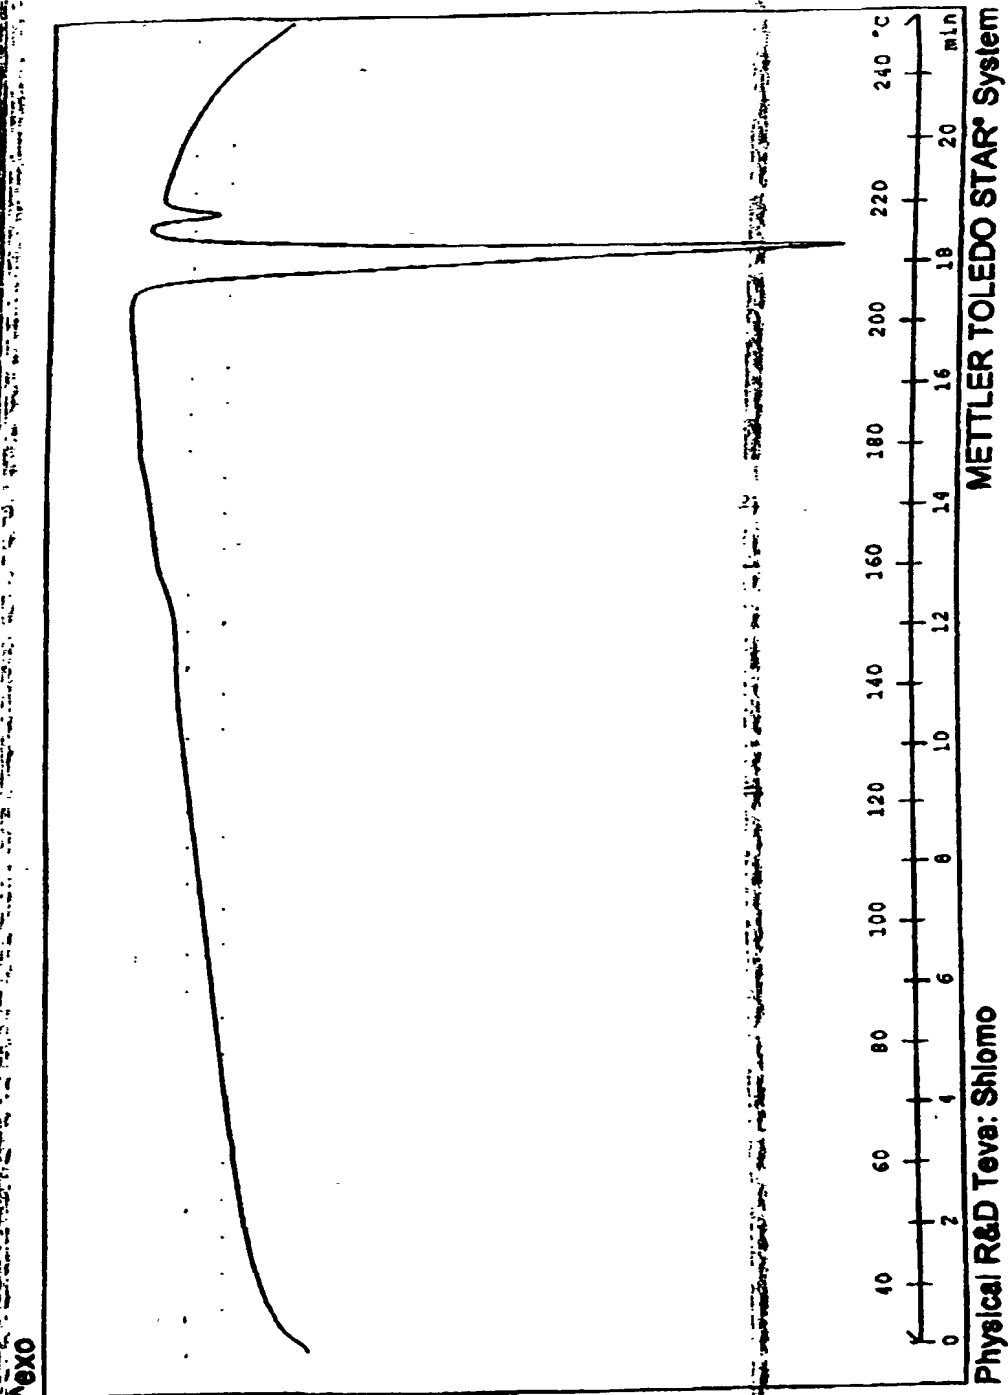


Figure 3



II

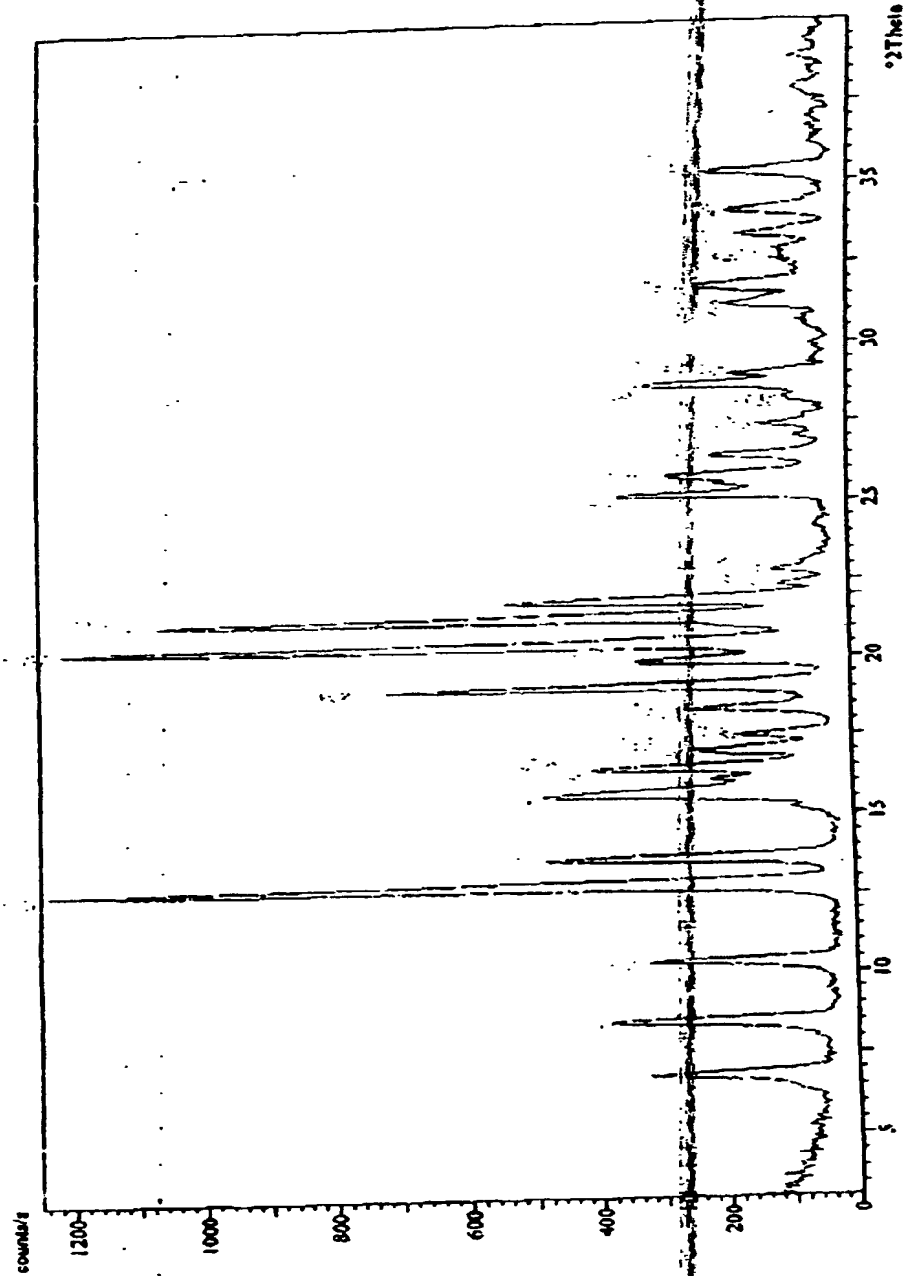


Figure 4


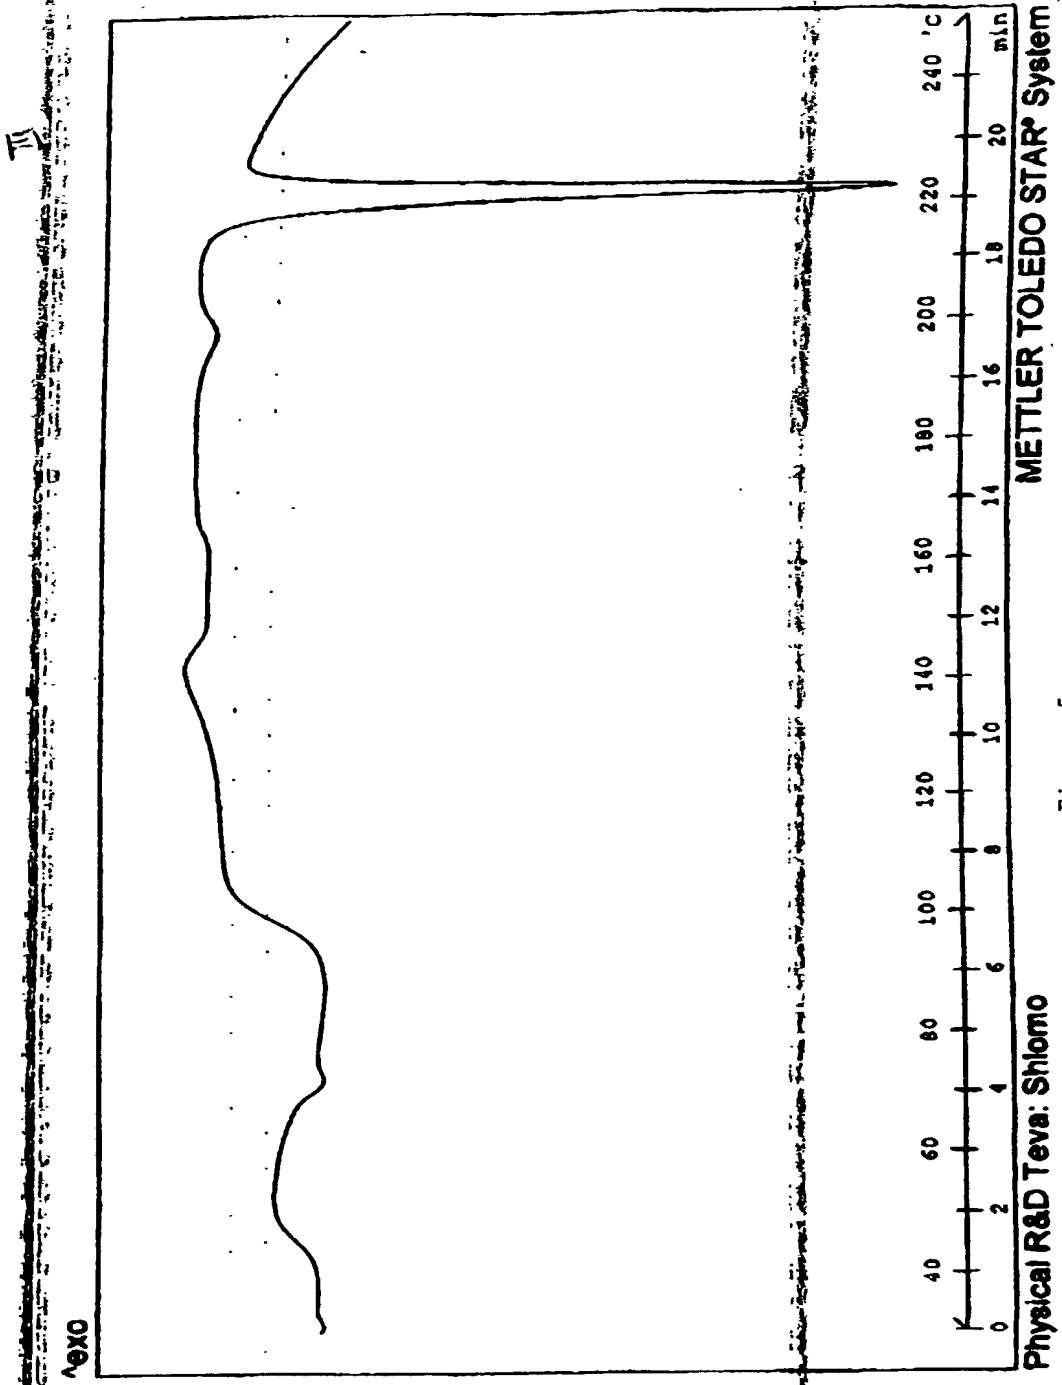


Figure 5





TOTAL P. 83

III


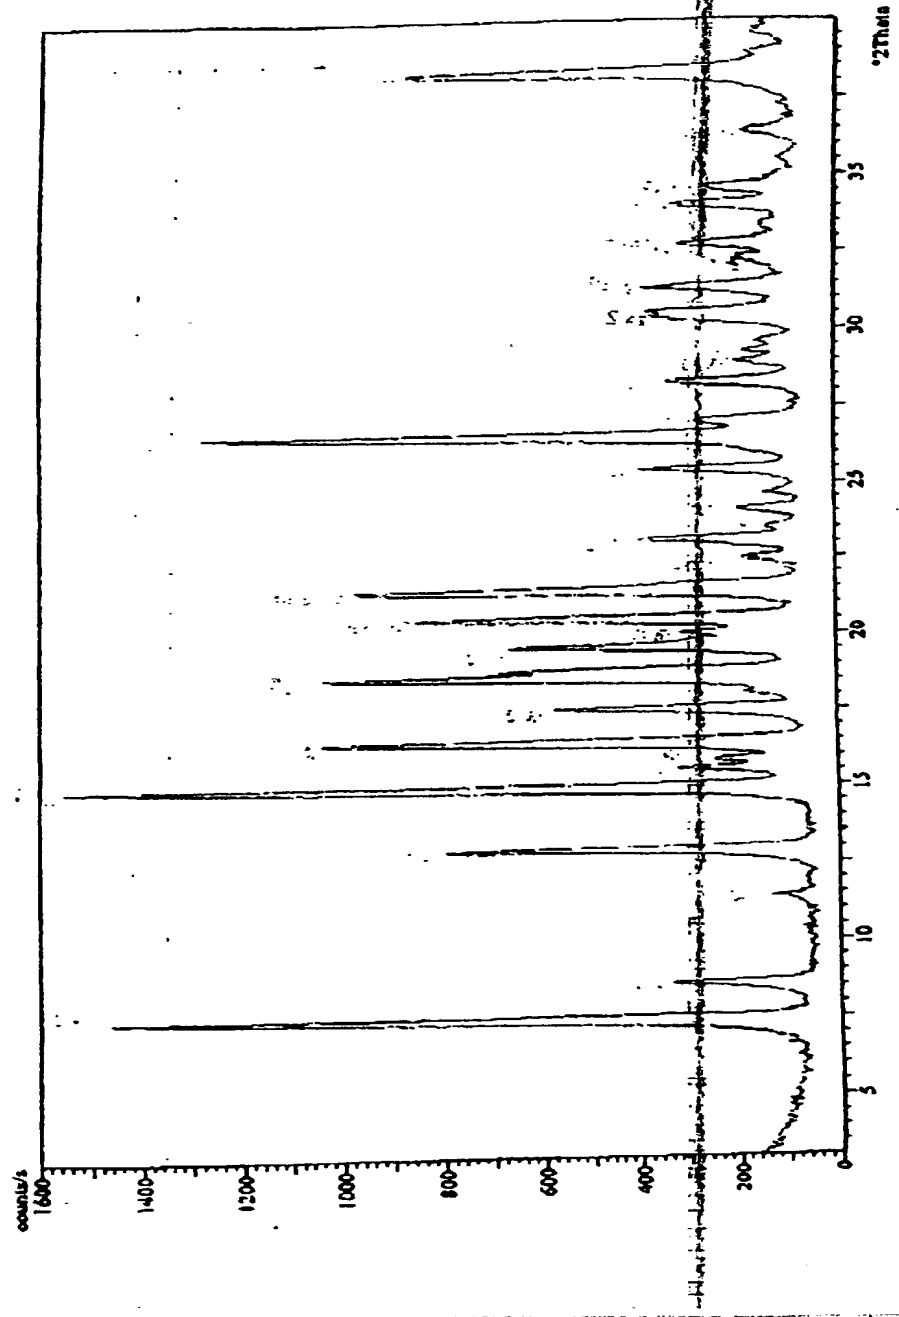


Figure 6

TV

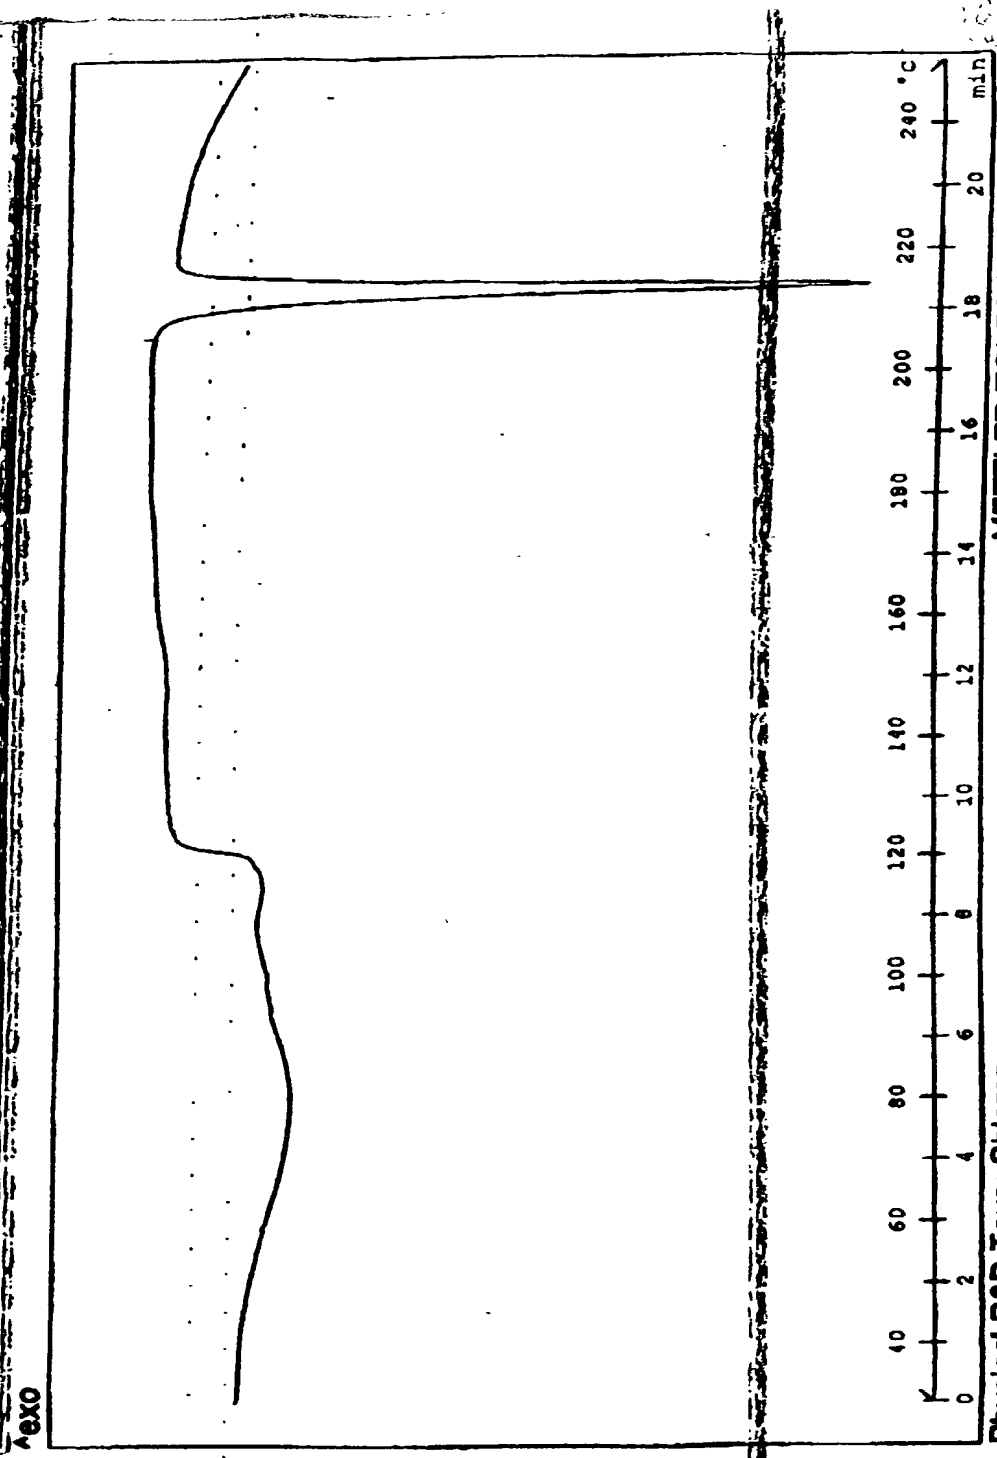

Physical R&D Teva: Shlomo

Figure 7



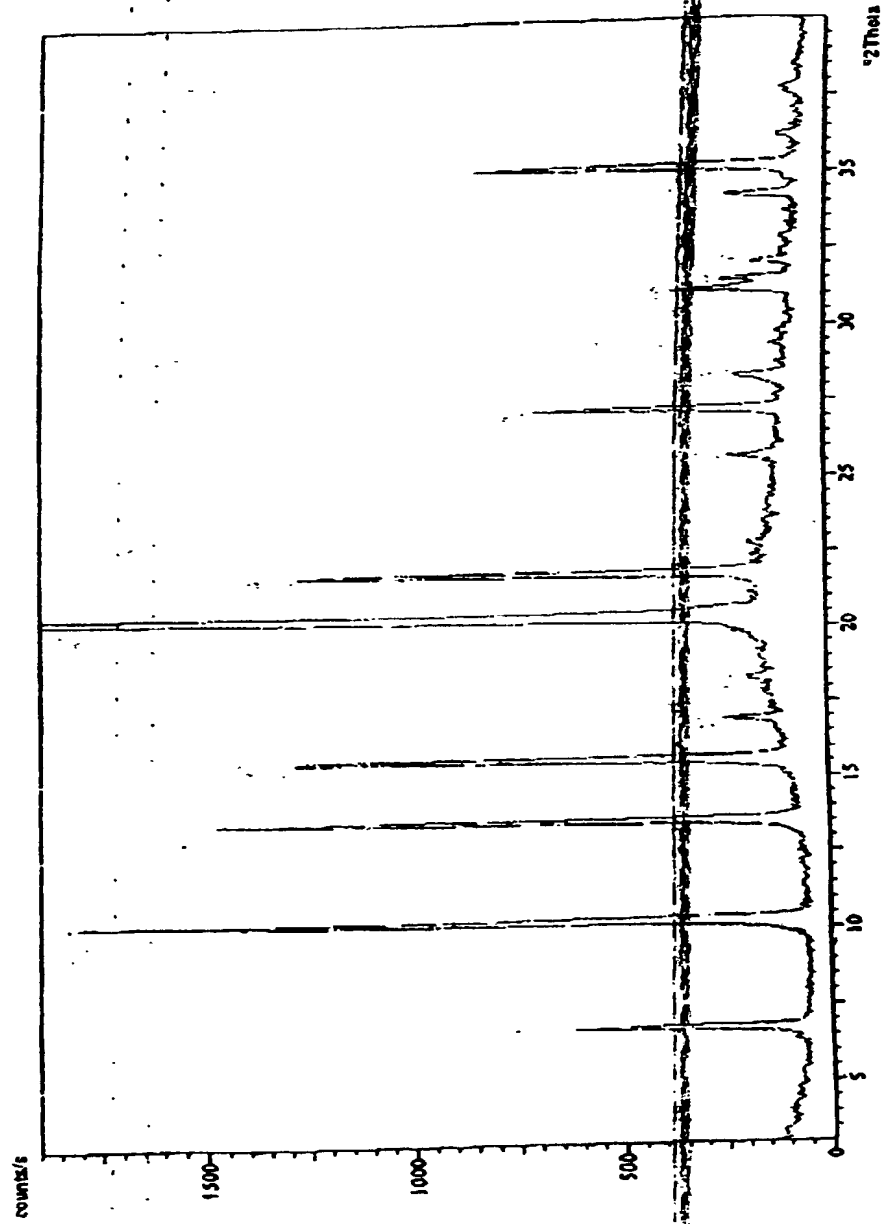


Figure 8



File: VML-07 SHQ, ID: VML-07 SHQ.  
 Date: 02/01/01 13:16 Step: 0.050° Cnt Time: 1.000 Sec.  
 Range: 2.00 - 40.00 (Deg) Cent. Scan Rate: 3.00 Deg/min. TSCA

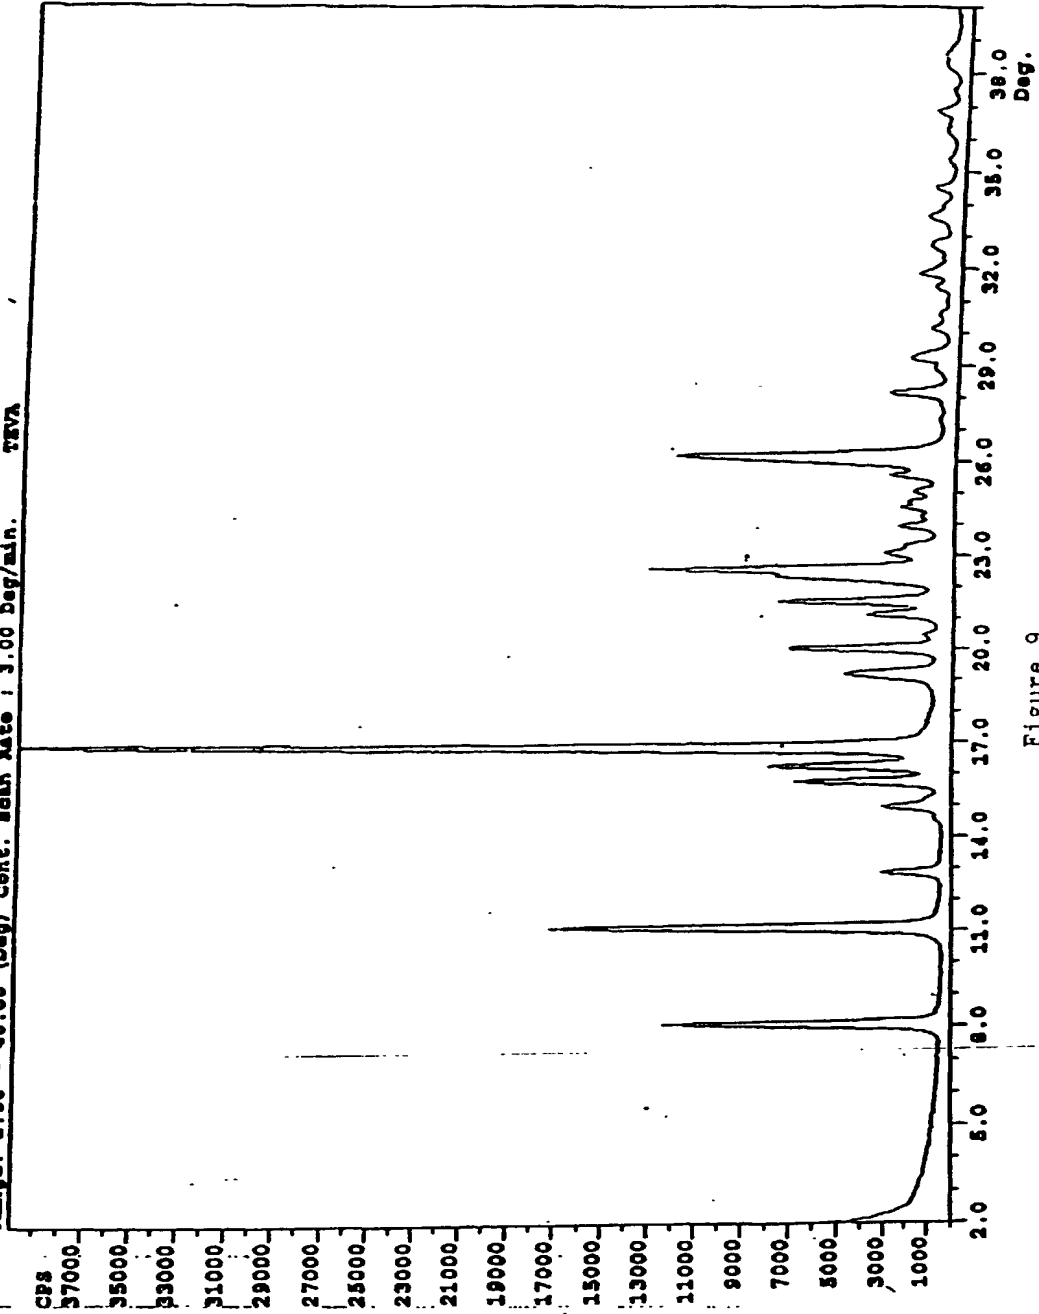


Figure 9

